

Evaporation Heat Transfer Characteristics of CO₂ in a Horizontal Tube

Dong-Geon Lee[†] · Chang-Hyo Son* · Hoo-Kyu Oh**

(Manuscript : Received MAR 31, 2005 ; Revised MAY 12, 2005)

Abstract : The evaporation heat transfer coefficient of CO₂ (R-744) in a horizontal tube was investigated experimentally. The experiments were conducted without oil in a closed refrigerant loop which was driven by a magnetic gear pump. The main components of the refrigerant loop are a receiver, a variable-speed pump, a mass flow meter, a pre-heater and evaporator (test section). The test section consists of a smooth, horizontal stainless steel tube of 7.75 mm inner diameter. The experiments were conducted at mass flux of 200 to 500 kg/m²s, saturation temperature of -5°C to 5°C, and heat flux of 10 to 40 kW/m². The test results showed the evaporation heat transfer of CO₂ has greatly effect on more nucleate boiling than convective boiling. The evaporation heat transfer coefficients of CO₂ are highly dependent on the vapor quality, heat flux and saturation temperature. The evaporation heat transfer coefficient of CO₂ is very larger than that of R-22 and R-134a. In making a comparison between test results and existing correlations, the present experimental data are the best fit for the correlation of Jung et al. But it was failed to predict the evaporation heat transfer coefficient of CO₂ using by the existing correlation. Therefore, it is necessary to develop reliable and accurate predictions determining the evaporation heat transfer coefficient of CO₂ in a horizontal tube.

Key words : Evaporation heat transfer coefficient, Carbon dioxide, Design of heat exchanger, Heat pump using of CO₂

1. Introduction

CFCs and HCFCs have been used widely as working fluids for refrigerator and air conditioner since the 1930s. But nowadays these refrigerants have been

identified as 'greenhouse gases', having artificial substances with higher ozone depletion potential(ODP) and global warming potential (GWP). This has prompted researchers worldwide to investigate the feasibility of natural

[†] Corresponding Author(Dept. of Refrigeration and A/C Eng., Graduate School, Pukyong National Uni.).
E-mail : trenc@korea.com, Tel : 051)621-6802

* Dept. of Refrigeration and A/C Eng., Graduate School, Pukyong National University

** Dept. of Refrigeration and A/C Eng, Pukyong National University

refrigerants in novel refrigeration cycles.

The natural refrigerants are naturally occurring substances, namely, carbon dioxide(CO_2), nitrogen (N_2), helium(He) and water(H_2O) represent a further 'natural' alternative. Among these natural refrigerants, CO_2 is not a new refrigerant and has a successful history of the use as a refrigerant. It has many advantages as a working fluid. For instance, the most attractive characteristics of CO_2 include non-toxicity, inflammability, negligible ODP and GWP, economically efficient if CO_2 is recovered. Moreover, because CO_2 has the high volumetric capacity for refrigerants and working pressure, it is possible to make a system compact⁽¹⁾.

For the refrigeration and air conditioning system using CO_2 as working fluid, the evaporator is a main component. Hence, study on the evaporation heat transfer characteristics be positively necessary. Especially, because of the large variation of specific volume, specific heat and surface tension in the evaporation heat transfer of CO_2 , some researchers present that the evaporation heat transfer of CO_2 is greatly different from that of conventional refrigerants, like HCFCs and HFCs. Due to complex flow pattern and thermophysical property, the heat transfer mechanism occurred during evaporation process of CO_2 is difficult to examine. Accurate theory for the evaporation heat transfer of CO_2 is not yet established. And, study on the evaporation heat transfer characteristics of CO_2 is limited, and few results have been published on CO_2 .

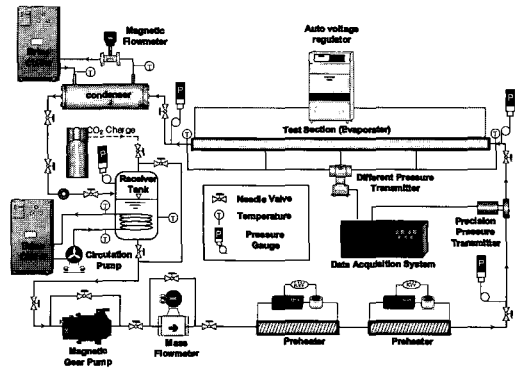


Fig. 1 Schematic diagram of experimental apparatus for heat transfer test.

Therefore, more comprehensive and fundamental study for major components is required to develop the enhanced refrigeration system. Especially, to design heat exchanger for CO_2 during evaporation process, the basic data for heat transfer characteristics of CO_2 are necessary. The purpose of this study is to offer the heat transfer characteristics during evaporation process of CO_2 .

2. Experimental Apparatus and Procedures

2.1 Test Facility

As shown in Fig. 1, the test rig is composed of magnetic gear pump, mass flow meter, preheater, heat transfer test section, liquid receiver, subcooler and brine chiller. The subcooling liquid of CO_2 in receiver was circulated through the mass flowmeter by means of magnetic gear pump. The refrigerant leaving the mass flowmeter in subcooling phase enters the preheater. The preheater is installed to obtain the desired inlet quality and pressure of CO_2 refrigerant.

The CO₂ enters the test section and then it is evaporated with flowing through the tube. The CO₂ refrigerant leaving the evaporator is completely condensed in subcooler and enters the receiver. The brine chiller is set up to control the given saturation temperature. As can be seen in Fig. 2, the outer tube of the test section was made of stainless steel tube (SUS 316) with the inner and outer diameter of 7.75 and 9.53 mm, respectively. The electronic power for the preheater was regulated by the auto voltage transformer and the electronic power for the preheater was regulated by the auto voltage transformer and the electronic power is provided for nichrome wire winding the outer wall of inner tube. The outside wall temperature on the heated tube was measured by T-type thermocouple mounted at the regular interval of 500 mm along the tube. T-type thermocouples to measure the temperature of the outer wall of the tube are attached at ten locations along the test section. At each point, the temperature at four circumferential locations was measured and the average values are used in calculating the heat

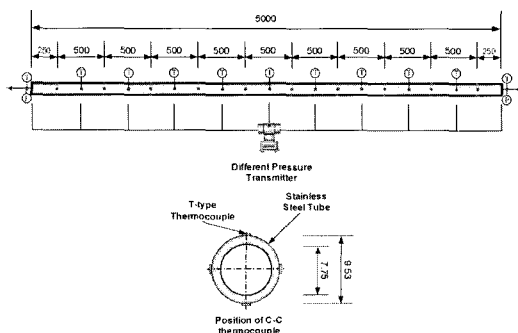


Fig. 2 Schematic diagram of test section for evaporation heat transfer test.

transfer coefficient. The inlet and outlet pressure in the test section were measured with a precision pressure transmitter. Table 1 presents the experimental conditions for evaporation heat transfer.

Table 1 Experimental conditions

Refrigerant	R-744(CO ₂)
ID of stainless steel tube(mm)	7.75
Mass flux (kg/m ² s)	200, 300, 400, 500
Saturation temperature (°C)	-5, 0, 5
Heat flux of test section (kW/m ²)	10, 20, 30, 40

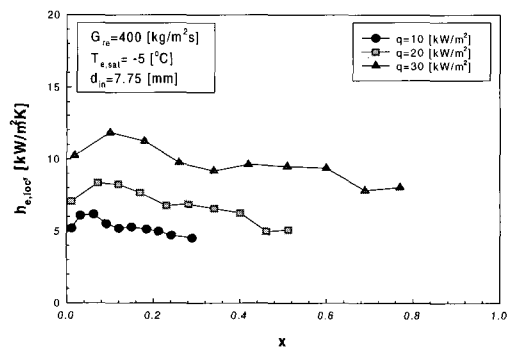


Fig. 3 Variation of the evaporation heat transfer coefficients for different heat flux.

2.2 Data Reduction

The local evaporation heat transfer coefficient of CO₂ had greatly influenced on the performance of this system. The local heat transfer coefficient in evaporation process could be evaluated by the following equation (1):

$$h_{e,loc} = \frac{q_e}{(T_{e,w,in} - T_e)} \tag{1}$$

where, $h_{e,loc}$ represents the local heat transfer coefficient in subsection of

evaporator. T_e is bulk refrigerant temperature, and $T_{e,w,in}$ is inner wall temperature calculated by one dimensional steady state concentric equation from measured outer wall temperature. The heat flux q_e supplied by auto voltage regulator was determined as follow.

$$q_e = \frac{Q}{\pi \cdot d_i \cdot dz} \quad (2)$$

where, dz indicates the effective length of a subsection, d_i is inner diameter of stainless steel tube.

3. Results and Discussion

3.1 Evaporation Heat Transfer

3.1.1 Influence of heat flux

Fig. 3 presents the variation of heat transfer coefficient with respect to heat flux at a given mass flux. The heat transfer coefficient decreases according to the vapor quality of which varies as heat flux increases. This indicates that nucleate boiling is generated even at high quality. As can be seen in Table 2, the reason is that the ratio of specific volumes of vapor to liquid phase of CO₂ is smaller than that of fluorocarbon refrigerants, and then the vapor velocity is not greater than the liquid velocity. Accordingly, the evaporation heat transfer coefficient of CO₂ has an effect on nucleate boiling at low quality as well as at high quality.

The heat transfer coefficient increases with heat flux, which is more evident over a wide range of quality. This shows

that the increased heat flux has no effect on evaporation heat transfer of CO₂. Zhao et al.^[2] showed that the heat transfer coefficient increased with a rise of heat flux at all qualities.

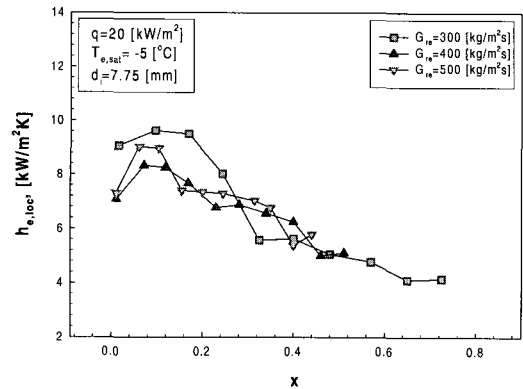


Fig. 4 Variation of the evaporating heat transfer coefficients for different mass fluxes at constant heat flux.

3.1.2 Influence of mass velocity


Fig. 4 shows the influences of varying mass flux on the heat transfer coefficient of CO₂ in a horizontal tube. As expected, the local evaporation heat transfer coefficient hardly increases mass flux increases. For this trend in Fig. 4, Pettersen^[3] showed that varying mass flux has almost no influence on heat transfer over a wide range of vapor quality. Hihara and Tanaka^[4] also observed this trend in their experiments.

As can be seen in Table 2, because the ratio of liquid to vapor density of CO₂ is small, the heat transfer of CO₂ has a great effect on more nucleate boiling than convective boiling. Therefore, mass flux of CO₂ does not affect on nucleate boiling too much, and there is no mass flux effect on evaporation heat transfer of CO₂.

Table 2 Thermophysical properties of refrigerants investigated.

Refrigerant			R744	R22	R134a
Density (kg/m ³)	Liquid	-5	956.7	1298	1311
		0	928.1	1282	1295
		5	896.7	1264	1278
	Vapor	-5	83.14	18.09	12.08
		0	97.32	21.23	14.43
		5	114.1	24.79	17.13
Conductivity (mW/mK)	Liquid	-5	116.7	97.09	94.24
		0	110.7	94.84	92.01
		5	104.5	92.61	89.8
	Vapor	-5	18.44	9.09	11.08
		0	19.93	9.42	11.51
		5	21.83	9.77	11.95

An important consequence of the test results with varying mass flux of CO₂ is that efficient compact CO₂ evaporators for refrigeration and air conditioning application can be designed with low mass flux. One reason for selecting low mass flux is that the evaporation heat transfer coefficient of CO₂ has no influence on increasing mass flux. Another reason is that flow distribution between parallel channels can be improved especially at low mass flux⁽³⁾.

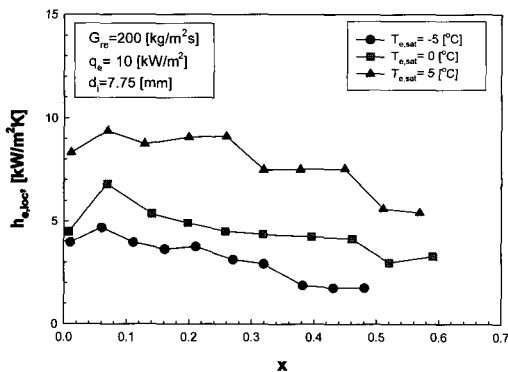**Fig. 5 Variation of the evaporating heat transfer with different saturation temperature for constant heat and mass flux.**

3.1.3 Influence of saturation temperature

Fig. 5 presents the variation of the heat transfer coefficients with respect to saturation temperature for a fixed mass flux. As expected, the heat transfer coefficient increases with saturation temperature of CO₂. This clearly shows that the increased heat transfer coefficient at higher saturation temperature is a result of nucleate boiling, which become more effective at higher pressure⁽⁴⁾.

These trend were also observed in the test results of Cho et al⁽⁵⁾. They showed that the heat transfer coefficients increase at all qualities as the evaporation temperature increases. They explained this reason that nucleate boiling is the predominant mechanism of evaporation heat transfer. In nucleate boiling, the vapor bubbles detach from heated surface plays an important role. As saturation temperature increases, the ratio of density of liquid to vapor is increased. Due to this reason, the buoyancy of vapor bubble increases, and the bubble detach is increased and finally, the nucleate boiling is activated. Cooper⁽⁶⁾ also explained that the heat transfer coefficient of nucleate boiling increases with increasing saturation temperature. The density difference between vapor and liquid is decreased at increasing saturation temperature. Due to this reason, the flow area of vapor bubble increases. In the end, the evaporation heat transfer coefficient of CO₂ has a great influence on saturation temperature.

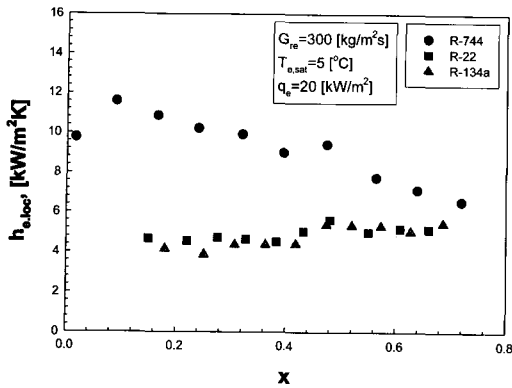


Fig. 6 Comparison of the heat transfer coefficients of R-744 with conventional refrigerants (R-22 and R-134a).

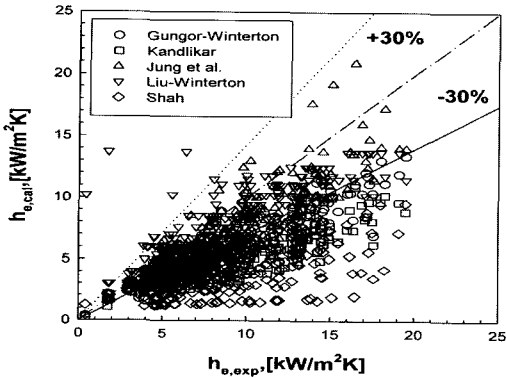


Fig. 7 Comparison between measured and calculated heat transfer coefficient.

3.1.4 Comparison of CO₂, R-22 and R-134a

Fig. 6 presents the comparison between the heat transfer coefficients of R-744 (CO₂) and those of R-22 and R-134a as Freon’s refrigerant. The test conditions are the same. The inlet saturation temperature is 5°C and the mass flux is kept at 300kg/m²s. Heat flux is 20kW/m². As shown in Fig. 6, at the quality region of 0.15 < x < 0.66, the heat transfer coefficient of CO₂ is about 87.2% and 93% higher than that of R-22 and R-134a, respectively. This phenomenon could be

attributed to higher liquid and vapor conductivity of CO₂ than those of R-22 and R-134a.

The heat transfer coefficients of R-134a and R-22 increase with increase in quality. But, those of CO₂ decrease with increase in vapor quality. Such differences are as a result of the different flow pattern of CO₂. The flow pattern of CO₂ is greatly affected by these fluid properties such as a much higher pressure, high vapor density, and low surface tension and low liquid viscosity. Thus, CO₂ offers outstanding heat transfer characteristics compared to traditional refrigerants such as CFCs and HCFCs. These attractive characteristics are mainly due to the excellent thermal properties of CO₂.

Table 3 The errors between measured and calculated heat transfer coefficient

	Averaged deviation(%)	Mean deviation(%)
Shah (1982)	-47.28	49.05
Gungor-Winterton (1986)	-32.39	32.7
Jung et al. (1989)	-14.26	21.64
Kandlikar (1989)	-38.9	39.22
Liu-Winterton (1991)	12.59	32.61

3.2 Comparison of experimental data and evaporation heat transfer correlations

In order to predict the local evaporation heat transfer coefficient in a horizontal tube, some researchers proposed their correlations, and these correlations are presented by Shah⁽⁷⁾, Gungor-Winterton⁽⁸⁾, Kandlikar⁽⁹⁾, Jung et al⁽¹⁰⁾, and Liu-Winterton⁽¹¹⁾. In this section, some

general correlations will be reviewed and compared to the experimental data, and confirmed this applicable possibility of their correlations.

Fig. 7 displays the comparison between the evaporation heat transfer coefficients obtained from the experiment and the correlations predicted by Shah, Gungor-Winterton, Kandlikar, Jung et al. and Liu-Winterton. All the correlations tend to underestimate the experimental heat transfer coefficients. Among the correlations, the best fit of the present test data is obtained with the correlation of Jung et al. Table 3 presents the errors between the calculated and experimental heat transfer coefficients.

4. Conclusions

In this section, for optimum design of refrigeration and air conditioning evaporator using CO₂ as working fluid, the heat transfer coefficients during the evaporation process of CO₂ in a horizontal tube have been investigated and the followings are the findings of this study.

(1) The heat transfer coefficients of R-134a and R-22 increase with quality, and those of CO₂ decrease with vapor quality. At the quality region of $0.15 < x < 0.66$, the heat transfer coefficient of CO₂ is about 87.2% and 93% higher than that of R-22 and R-134a, respectively. The resulting "unusual" properties of CO₂ give heat transfer characteristics that are very different from those of conventional refrigerants.

(2) In a horizontal tube, the evaporation

heat transfer coefficient obtained in the experimental data of CO₂ was compared with the several existing heat transfer correlations. The existing correlations for heat transfer coefficient underestimated the experimental data of CO₂. Among existing correlations, Jung et al.'s correlation shows an agreement to experimental data

(3) As mentioned earlier, comprehensive studies related to evaporation heat transfer were carried out experimentally, including heat transfer during evaporation process of CO₂. The local heat transfer coefficients of CO₂ during evaporation process are highly dependent on heat flux and saturation temperature. In these circumstances, conventional models of the local heat transfer coefficient do not apply, so, the new evaporation heat transfer correlation of CO₂ in a horizontal tube should be developed through various experimental data.

Nomenclature

d	diameter of tube	m
G	mass flux	kg/m ² s
h	heat transfer coefficient	kW/m ² K
P	pressure	Pa
Q	heat capacity	kW
q	heat flux	kW/m ²
T	temperature	°C
x	vapor quality	
dz	length of subsection	m

Subscripts

e	evaporation
---	-------------

i	inside
in	inlet
loc	local
re	refrigerant

Acknowledgement

The work presented in this paper is part of the project 'Development of high efficient cooling and heating system using natural refrigerant of CO₂' sponsored by Ministry of Commerce, Industry, and Energy. The support of these sponsors is gratefully acknowledged.

References

- [1] Lorentzen, G. and Pettersen, J., A new, efficient and environmentally benign system for car air-conditioning, *International Journal of Refrigeration*, Vol. 16, No. 1, pp. 4-12, 1993.
- [2] Zhao, Y., Ohadi, M. M., Dessiatoun, S. V., Molki, M., Darabi, J., Forced convection boiling heat transfer of CO₂ in horizontal tube, in : AJTE99-6249, Proc. 5th ASME/JSME Joint Thermal Engineering Conference, San Diego, California, 1999.
- [3] Pettersen, J., Two-phase flow pattern, heat transfer and pressure drop in microchannel vaporization of CO₂, *ASHRAE Transaction (Symposia)*, pp. 523-532, 2003.
- [4] Hihara, E. and Tanaka, S., Boiling Heat Transfer of Carbon dioxide in Horizontal Tubes, Proc. 4th IIR-Gustav Lorentzen Conf. On Natural Working Fluids, Purdue University, USA, pp. 279-284, 2000.
- [5] Cho, E. S., Yoon, S. H., and Kim, M. S., A study on the characteristics of evaporative heat transfer for carbon dioxide in a horizontal tube, in: *Proceedings of the KSME Spring Annual Meeting*, pp. 104-107, 2000.
- [6] Cooper, M. G., Heat Flow Rates in Saturated Nucleate Pool Boiling a Wide-ranging Examination Using Reduced Properties, *Advances in Heat Transfer*, Vol. 16, pp. 157-239, 1984.
- [7] Shah, M. M., A general correlation for heat transfer during film condensation inside pipes, *International Journal of Heat and Mass Transfer*, Vol. 22, pp. 157-165, 1979.
- [8] Gungor, K. E. and Winterton, R. H. S., Simplified General Correlation for Flow Saturated Boiling and Comparisons of Correlations with Data, *Chem. Eng. Res. Des.*, Vol. 65, pp. 148-156, 1987.
- [9] Kandlikar, S.G., "A general correlation for saturated two-phase flow boiling horizontal and vertical tubes", *Trans. ASME*, Vol. 112, pp. 219-228, 1990.
- [10] Jung, D.S., McLinden, M., Randermacher, R., and Didion, D., "A study of flow boiling heat transfer with refrigerant mixtures", *International Journal of Heat and Mass Transfer*, Vol. 32, No. 9, pp. 1751-1764, 1989.
- [11] Liu, Z. and Winterton, R. H. S., A General Correlation for Saturated and Subcooled Flow Boiling in Tubes and Annuli, Based on a Nucleate Pool

Boiling Equation, Int. J. Heat and Mass Transfer, Vol. 34, No. 1, pp. 2759-2766, 1991.

Author Profile



Chang-Hyo Son

He received the M.S. and Ph. D. degree in department of refrigeration and air-conditioning engineering from Pukyong National University in 2000 and 2004. He is pursuing the P. D. degree at Pukyong National University. He is interested in development and

construction of refrigeration system using CO₂.



Dong-Geon Lee

He received the M.S. degree in department of refrigeration and air-conditioning engineering from Pusan Fishery University in 1961. He is pursuing the Ph. D. degree at Pukyong National University. He is interested in development and construction of refrigeration and cold storage system using CO₂.



Hoo-Kyu Oh

He received the M.S. and B.S. degree in department of food engineering from Pusan Fishery University in 1948 and 1977. He received the Ph. D. degree in department of mechanical engineering at Waseda University. He is interested in development and

construction of various refrigeration/cold system and high efficiency heat exchanger.