

# A Simultaneous Perturbation Stochastic Approximation (SPSA)-Based Model Approximation and its Application for Power System Stabilizers

Hee-Sang Ko, Kwang Y. Lee, and Ho-Chan Kim\*

**Abstract:** This paper presents an intelligent model; named as free model, approach for a closed-loop system identification using input and output data and its application to design a power system stabilizer (PSS). The free model concept is introduced as an alternative intelligent system technique to design a controller for such dynamic system, which is complex, difficult to know, or unknown, with input and output data only, and it does not require the detail knowledge of mathematical model for the system. In the free model, the data used has incremental forms using backward difference operators. The parameters of the free model can be obtained by simultaneous perturbation stochastic approximation (SPSA) method. A linear transformation is introduced to convert the free model into a linear model so that a conventional linear controller design method can be applied. In this paper, the feasibility of the proposed method is demonstrated in a one-machine infinite bus power system. The linear quadratic regulator (LQR) method is applied to the free model to design a PSS for the system, and compared with the conventional PSS. The proposed SPSA-based LQR controller is robust in different loading conditions and system failures such as the outage of a major transmission line or a three phase to ground fault which causes the change of the system structure.

**Keywords:** Free model, linear quadratic regulator, power system stabilization, simultaneous perturbation stochastic approximation.

## 1. INTRODUCTION

Traditionally, controllers are designed on the basis of a mathematical description of a system and its linearized model. Therefore, it is difficult to implement these model-based controllers to a real system, especially, to a system, which is complex and nonlinear such as power systems. A power system stabilizer (PSS) with the excitation system is the most common tool used to enhance the damping of low frequency oscillations of a power system [1,2]. Considerable effort has been made to design PSS for power systems, most of which is based on deMello and Concordia's pioneering work [1]. They use a linearized model to find a proper set of parameters in a fixed structure PSS. Linear optimal control and

modern control theories are also introduced to improve the dynamic performance of power systems under the uncertainty of power system models [3-5]. These techniques, however, depend on the accuracy of the model, which is less reliable as the power system becomes larger. Adaptive techniques are also employed in the PSS design for a wide range of operations [6-8]. Recently, intelligent control, so called artificial neural networks and fuzzy logic, has attracted the attention of power system engineers. There has been a great deal of research that reports on artificial neural network and fuzzy logic and its application to control and power systems [9-13].

This paper presents the free model approach for system identification using input and output data and its application to design a PSS. The free model concept is introduced as an alternative intelligent system technique to design a controller for an unknown dynamic system with input and output data only, and it does not require the knowledge of mathematical model for the system. The idea of free model comes from the Taylor series approximation, where an output can be estimated when such data as position, velocity, and acceleration are known. One of the techniques using only a loss function measurement that has attracted considerable recent attention for difficult multivariate problems is the simultaneous perturbation stochastic approximation (SPSA) method

Manuscript received February 29, 2008; accepted May 28, 2008. Recommended by Guest Editor Seung Ki Sul.

Hee-Sang Ko is with the Samsung Heavy Industries Co., 530 Jangpyeong-ri, Sinhyeon-eup, Geoje-si, Gyeongnam 656-710, Korea (e-mail: heesang2008.ko@samsung.com).

Kwang Y. Lee is with the Department of Electrical & Computer Engineering, Baylor University, One Bear Place #97356, Waco, TX 76798-7356, USA (e-mail: Kwang\_Y\_Lee@baylor.edu).

Ho-Chan Kim is with the Department of Electrical Engineering, Cheju National University, 66 Jejudaehakno, Jeju, Jeju Province 690-756, Korea (e-mail: hckim@cheju.ac.kr).

\* Corresponding author.

introduced in Spall [14] and more fully analyzed in Spall [15]. SPSA is based on a highly efficient and easy to implement “simultaneous perturbation” approximation to the gradient: this gradient approximation uses only two cost function measurements independent of the number of parameters being optimized. The parameters of the free model can be obtained by SPSA method using the input-output data and a controller can be designed based on the free model. The free model is then transformed to a linear state space model and the linear quadratic regulator (LQR) method [16] is used to design a controller. In this paper, one machine infinite bus system [17,18] is studied to demonstrate the feasibility of the proposed method.

The LQR method is applied to the free model to design PSS for the systems, and compared with the conventional PSS (CPSS). The SPSA based LQR controller is applied to the test systems and compared with the CPSS. Although no mathematical model is used to design the controller, the proposed controller is robust in different loading conditions and system failures such as the outage of a major transmission line or a three phase to ground fault.

## 2. DESCRIPTION OF THE FREE MODEL

Consider a nonlinear time-invariant discrete-time system, represented by

$$y(k+1) = f(y(k), y(k-1), \dots, y(k-N), u(k), u(k-1), \dots, u(k-M)), \quad (1)$$

where  $y(k-i)$  and  $u(k-j)$ ,  $i=0,1,\dots,N$ ,  $j=0,1,\dots,M$ , denote the delayed outputs and inputs, respectively.

It can be shown that the delayed signals are made of increments or differences. The backward difference operator [19,20] is defined as

$$\begin{aligned} \Delta^n f(k) &= \Delta^{n-1} f(k) - \Delta^{n-1} f(k-1), \quad n \geq 1, \\ \Delta^0 f(k) &= f(k). \end{aligned} \quad (2)$$

Using the difference operator (2), the system (1) can be represented as

$$y(k+1) = f(y(k), \Delta y(k), \dots, \Delta^N y(k), u(k), u(k-1), \Delta u(k-1), \dots, \Delta^M u(k-1)). \quad (3)$$

Equation (3) is expanded into Taylor series.

$$\begin{aligned} y(k+1) &= f(y(k), \Delta y(k), \dots, \Delta^N y(k), u(k), u(k-1), \\ &\quad \Delta u(k-1), \dots, \Delta^M u(k-1)) \\ &= f(y(k-1), \dots, \Delta^N y(k-1), u(k-1), \\ &\quad u(k-2), \dots, \Delta^M u(k-2)) \end{aligned}$$

$$\begin{aligned} &+ \left( \frac{\partial f}{\partial y(k-1)} \right) (y(k) - y(k-1)) + \dots \\ &+ \left( \frac{\partial f}{\partial \Delta y^N(k-1)} \right) (\Delta^N y(k) - \Delta^N y(k-1)) \\ &+ \left( \frac{\partial f}{\partial u(k-1)} \right) (u(k) - u(k-1)) + \dots \\ &+ \left( \frac{\partial f}{\partial \Delta u^M(k-2)} \right) (\Delta^M u(k-1) - \Delta^M u(k-2)) + O(k) \\ &= y(k) + \sum_{i=1}^N a_i \Delta^i y(k) + b_0 \Delta u(k) + \sum_{i=1}^M b_i \Delta^i u(k-1) + O(k), \end{aligned} \quad (4)$$

where  $a_i = \frac{\partial f}{\partial \Delta^i y(k-1)}$ ,  $b_0 = \frac{\partial f}{\partial u(k-1)}$ ,  $b_i = \frac{\partial f}{\partial \Delta^i u(k-2)}$ , and  $O(k)$  represents the high order terms.

By subtracting  $y(k)$  from (4), the above equation is represented as following:

$$\begin{aligned} \Delta y(k+1) &= \sum_{i=1}^N a_i \Delta^i y(k) + b_0 \Delta u(k) \\ &\quad + \sum_{i=1}^M b_i \Delta^i u(k-1) + O(k). \end{aligned}$$

The free model is then defined as following by neglecting high order terms:

$$\Delta \hat{y}(k+1) = \sum_{i=1}^N a_i \Delta^i y(k) + b_0 \Delta u(k) + \sum_{i=1}^M b_i \Delta^i u(k-1), \quad (5a)$$

or dividing both sides with  $\Delta$ ,

$$\hat{y}(k+1) = \sum_{i=1}^N a_i \Delta^{i-1} y(k) + b_0 u(k) + \sum_{i=1}^M b_i \Delta^{i-1} u(k-1), \quad (5b)$$

where  $N$  and  $M$  are the order of the free model for output and input, respectively, and  $\hat{y}(k+1)$  denotes the estimate of  $y(k+1)$ . The remaining problem is how to determine parameters  $a_i$ ,  $b_0$ , and  $b_i$ . To determine parameters, SPSA method is applied [14,15]. The least squares problem is to minimize the loss function  $E(\theta)$  that is a sum of squares.

$$\min E(\theta) = \sum_{i=1}^n (y(k-i+1) - \hat{y}(k-i+1))^2, \quad (6)$$

where  $\theta = [a_1 \dots a_N b_0 \dots b_M]^T$  is the parameter vector of a free model and  $y$  and  $\hat{y}$  indicate the plant output and estimated output of a free model, respectively.

The least squares problem is to minimize the loss function (6) with respect to  $p$  number of parameters, where  $p = N+M+1$ . There a number of methods in solving this problem, which all require at least  $p$  measurement of the loss function. This may be a problem for a large number of parameters to estimate. An alternative method is the use of simultaneous perturbation stochastic approximation (SPSA) [15]. The SPSA is based on a highly efficient and easy to implement “simultaneous perturbation” approximation to the gradient: this gradient approximation uses only two cost function measurements independent of the number of parameters being optimized.

### 3. SPSA BASED FREE MODEL APPROXIMATION

#### 3.1. The basic SPSA algorithm [15]

The goal is to minimize a loss function  $L(\theta)$ , where the loss function is a scalar-valued “performance measure” and  $\theta$  is a continuous-valued  $p$ -dimensional vector of parameters to be adjusted. The SPSA algorithm works by iterating from an initial guess of the optimal, where the iteration process depends on the above-mentioned highly efficient “simultaneous perturbation” approximation to the gradient  $g(\theta) \equiv \partial L(\theta) / \partial \theta$ .

Assume that measurements of the loss function are available at any value of  $\theta$ :

$$E(\theta) = L(\theta) + \text{noise}.$$

For example, in a Monte Carlo simulation-based optimization context,  $L(\theta)$  may represent the mean response with input parameters  $\theta$ , and  $E(\theta)$  may represent the outcome of one simulation experiment at  $\theta$ . In some problems, exact loss function measurements will be available. This corresponds to the  $\text{noise} = 0$  setting (and in the simulation example, would correspond to a deterministic non-Monte Carlo-simulation). Note that no direct measurements (with or without noise) of the gradient are assumed available. This measurement formulation is identical to that of the finite-difference stochastic approximation (FDSA) algorithm and most implementations of genetic optimization algorithms and simulated annealing. It differs from Newton-Raphson search, and maximum likelihood scoring, all of which require direct measurement or calculation of  $g(\theta)$ .

It is assumed that  $L(\theta)$  is a differentiable function of  $\theta$  and that the minimum point  $\theta^*$  corresponds to a zero point of the gradient, i.e.,

$$g(\theta^*) = \left. \frac{\partial L(\theta)}{\partial \theta} \right|_{\theta=\theta^*} = 0. \quad (7)$$

In cases where more than one point satisfies (7), then the algorithm may only converge to a local minimum (as a consequence of the basic recursive form of the algorithm there is generally no risk of converging to a maximum or saddlepoint of  $L(\theta)$ , i.e., to nonminimum points where  $g(\theta)$  may equal zero). The modifications of basic SPSA algorithm allow it to search for the global solution among multiple local solutions. Note also that (7) is generally associated with unconstrained optimization; however, through the application of penalty function and/or projection methods, it is possible to use (7) in a constrained problem (i.e., one where the  $\theta$  values are not allowed to obtain certain values, usually as specified through equality and inequality constraints on the values of  $\theta$  or  $L(\theta)$ ).

The basic unconstrained SPSA algorithm is in the general recursive stochastic approximation (SA) form

$$\hat{\theta}_{k+1} = \hat{\theta}_k - a_k \hat{g}_k(\hat{\theta}_k), \quad (8)$$

where  $\hat{g}_k(\hat{\theta}_k)$  is the simultaneous perturbation estimate of the gradient  $g(\theta) \equiv \partial L(\theta) / \partial \theta$  at the iterate  $\hat{\theta}_k$  based on the measurements of the loss function and  $a_k$  is a nonnegative scalar gain coefficient.

The essential part of (8) is the gradient approximation  $\hat{g}_k(\hat{\theta}_k)$ . This gradient approximation is formed by perturbing the components of  $\hat{\theta}_k$  one at a time and collecting a loss measurement  $E(\bullet)$  at each of the perturbations (in practice, the loss measurements are sometimes noise-free,  $E(\bullet) = L(\bullet)$ ). This requires  $2p$  loss measurements for a two-sided finite difference approximation. All elements of  $\hat{\theta}_k$  are randomly perturbed together to obtain two loss measurements  $E(\bullet)$ . For the two-sided simultaneous perturbation gradient approximation, this leads to

$$\hat{g}_k(\hat{\theta}_k) = \frac{E(\hat{\theta}_k + c_k \Delta_k) - E(\hat{\theta}_k - c_k \Delta_k)}{2c_k} \begin{bmatrix} \Delta_{k1}^{-1} \\ \Delta_{k2}^{-1} \\ \vdots \\ \Delta_{kp}^{-1} \end{bmatrix}, \quad (9)$$

where the mean-zero  $p$ -dimensional random perturbation vector,  $\Delta_k = [\Delta_{k1}, \Delta_{k2}, \dots, \Delta_{kp}]^T$ , has a user-specified distribution and  $c_k$  is a positive scalar. (The notation for perturbation vector should not be confused with the difference operator defined in (2).) Because the numerator is the same in all  $p$

components of  $\hat{g}_k(\hat{\theta}_k)$ , the number of loss measurements needed to estimate the gradient in SPSA is two, regardless of the dimension  $p$ .

### 3.2. The SPSA algorithm implementation for free model approximation

The step-by-step summary below shows how SPSA iteratively produces a sequence of estimates.

#### Step 1: Initialization and coefficient selection.

Set counter index  $k=0$ . Pick initial guess  $\hat{\theta}_0$  in (8) and nonnegative coefficients  $a, c, A, \alpha$ , and  $\gamma$  in the SPSA gain sequences  $a_k = a/(A+k+1)^\alpha$  and  $c_k = c/(k+1)^\gamma$ . Practically effective (and theoretically valid) values for  $\alpha$  and  $\gamma$  are 0.602 and 0.101, respectively.

#### Step 2: Generation of simultaneous perturbation vector.

Generate by Monte Carlo a  $p$ -dimensional random perturbation vector  $\Delta_k$ , where each of the  $p$  components of  $\Delta_k$  are independently generated from a zero-mean probability distribution satisfying the conditions in Spall [15]. A simple (and theoretically valid) choice for each component of  $\Delta_k$  is to use a Bernoulli  $\pm 1$  distribution with probability of 0.5 for each  $\pm 1$  outcome. Note that uniform and normal random variables are not allowed for the elements of  $\Delta_k$  by the SPSA regularity conditions since they have infinite inverse moments.

#### Step 3: Loss function evaluations.

Obtain two measurements of the loss function based on the simultaneous perturbation around the current  $\hat{\theta}_k$ :  $E(\hat{\theta}_k + c_k \Delta_k)$  and  $E(\hat{\theta}_k - c_k \Delta_k)$  in (6) with the  $c_k$  and  $\Delta_k$  from Steps 1 and 2.

#### Step 4: Gradient approximations.

Generate the simultaneous perturbation approximation to the unknown gradient  $\hat{g}_k(\hat{\theta}_k)$  according to (9). It is sometimes useful to average several gradient approximations at  $\hat{\theta}_k$ , each formed from an independent generation of  $\Delta_k$ .

#### Step 5: Updating $\theta$ Estimate.

Use the standard stochastic approximation form in (8) to update  $\hat{\theta}_k$  to a new value  $\hat{\theta}_{k+1}$ . Check for constraint violation and modify the updated  $\theta$ .

#### Step 6: Iteration or Termination.

Return to Step 2 with  $k+1$  replacing  $k$ . Terminate the algorithm if there is little change in several successive iterates or the maximum allowable number of iterations has been reached.

The choice of the gain sequences ( $a_k$  and  $c_k$ ) is critical to the performance of SPSA (as with all

stochastic optimization algorithms and the choice of their respective algorithm coefficients). With  $\alpha$  and  $\gamma$  as specified in Step 1, one typically finds that in a high-noise setting (i.e., poor quality measurements of  $L(\theta)$ ) it is necessary to pick a smaller  $a$  and larger  $c$  than in a low-noise setting. Although the asymptotically optimal values of  $\alpha$  and  $\gamma$  are 1.0 and 1/6, respectively, it appears that  $\alpha < 1.0$  choosing usually yields better finite-sample performance through maintaining a larger step size; hence the recommendation in Step 1 to use values ( $\alpha$  and  $\gamma$ ) that are effectively the lowest allowable satisfying the theoretical conditions mentioned [15]. In a setting where a large amount of data are likely to be available, it may be beneficial to convert to  $\alpha=1$  and  $\gamma=1/6$  at some point in the iteration process to take advantage of their asymptotic optimality.

## 4. STATE SPACE REALIZATION AND LQR DESIGN

Free model can be easily adopted to design controllers with conventional design method. In this paper, a LQR is applied to design a controller that is called the SPSA-based optimal controller. First, a linear transformation is introduced to convert the free model into a linear model so that the LQR design method can be applied [16]. The state variables are defined by the following linear transformation:

$$\begin{aligned} x_1(k) &= y(k), \\ x_2(k) &= \Delta y(k) + \beta_1 u(k-1), \\ x_3(k) &= \Delta^2 y(k) + \beta_2 u(k-1) + \beta_1 \Delta u(k-1), \\ &\vdots \\ x_N(k) &= \Delta^{N-1} y(k) + \beta_{N-1} u(k-1) + \dots \\ &\quad + \beta_1 \Delta^{N-2} u(k-1). \end{aligned} \quad (10)$$

From the linear transformation (10), the  $i$ th state variable is defined by

$$x_i(k) = \Delta^{i-1} y(k) + \sum_{m=0}^{i-2} \beta_{i-m-1} \Delta^m u(k-1), \quad (11)$$

where  $i=1, 2, \dots, N$ , and  $\beta_0 = 0$ . Solving for the output increments,

$$\begin{aligned} y(k) &= x_1(k), \\ \Delta y(k) &= x_2(k) - \beta_1 u(k-1), \\ \Delta^2 y(k) &= x_3(k) - \beta_2 u(k-1) - \beta_1 \Delta u(k-1), \\ &\vdots \\ \Delta^{i-1} y(k) &= x_i(k) - \beta_{i-1} \Delta u(k-1) - \beta_{i-2} \Delta^2 u(k-1) \\ &\quad - \beta_{i-3} \Delta^3 u(k-1) - \dots - \beta_1 \Delta^{i-2} u(k-1). \end{aligned} \quad (12)$$

Then applying (12) into (5b) and replacing  $\hat{y}(k+1)$  with  $y(k+1)$ ,

$$y(k+1) = \sum_{i=1}^N a_i \Delta^{i-1} y(k) + b_0 u(k) + \sum_{i=1}^{N-1} b_i \Delta^{i-1} u(k-1), \quad (13)$$

which can be represented as the following equation:

$$\begin{aligned} x_1(k+1) &= y(k+1) \\ &= \sum_{i=1}^N a_i (x_i(k) - \beta_{i-1} u(k-1) - \beta_{i-2} \Delta u(k-1) \\ &\quad - \beta_{i-3} \Delta^2 u(k-1) - \dots - \beta_1 \Delta^{i-2} u(k-1)) \\ &\quad + b_0 u(k) + \sum_{i=1}^{N-1} b_i \Delta^{i-1} u(k-1) \end{aligned}$$

or

$$\begin{aligned} x_1(k+1) &= \sum_{i=1}^N a_i x_i(k) + b_0 u(k) + (b_1 - a_2 \beta_1 - a_3 \beta_2 \dots \\ &\quad - a_N \beta_{N-1}) u(k-1) \\ &\quad + (b_2 - a_3 \beta_1 - a_4 \beta_2 \dots - a_N \beta_{N-2}) \Delta^1 u(k-1) \\ &\quad + (b_3 - a_4 \beta_1 - \dots - a_N \beta_{N-3}) \Delta^2 u(k-1) \\ &\quad + \dots + (b_{N-1} - a_N \beta_1) \Delta^{N-2} u(k-1). \end{aligned} \quad (14)$$

Choose  $\beta_i$  so that the coefficients of  $\Delta^i u(k-1)$  become zeros, i.e.,

$$\begin{bmatrix} a_2 & a_3 & \dots & a_N \\ a_3 & a_4 & \dots & 0 \\ \vdots & \vdots & \ddots & 0 \\ a_N & 0 & 0 & 0 \end{bmatrix} \begin{bmatrix} \beta_1 \\ \beta_2 \\ \vdots \\ \beta_{N-1} \end{bmatrix} = \begin{bmatrix} b_1 \\ b_2 \\ \vdots \\ b_{N-1} \end{bmatrix}. \quad (15)$$

Then, (14) becomes

$$x_1(k+1) = \sum_{m=1}^N a_m x_m(k) + b_0 u(k). \quad (16)$$

Now, it remains to derive the  $x_i(k+1)$  for  $i \geq 2$ . From the definition of the backward difference operator, and (11),

$$\begin{aligned} \Delta x_{i-1}(k+1) &= x_{i-1}(k+1) - x_{i-1}(k) \\ &= \left\{ \Delta^{i-2} y(k+1) + \sum_{m=1}^{i-2} \beta_{i-m-1} \Delta^{m-1} u(k) \right\} \\ &\quad - \left\{ \Delta^{i-2} y(k) + \sum_{m=1}^{i-2} \beta_{i-m-1} \Delta^{m-1} u(k-1) \right\} \\ &= \Delta^{i-1} y(k+1) + \sum_{m=1}^{i-2} \beta_{i-m-1} \Delta^m u(k). \end{aligned} \quad (17)$$

From (17)

$$\begin{aligned} \Delta^{i-1} y(k+1) &= x_{i-1}(k+1) - x_{i-1}(k) \\ &\quad - \sum_{m=1}^{i-2} \beta_{i-m-1} \Delta^m u(k). \end{aligned} \quad (18)$$

In (11), the state equation of the  $i$ th state variable is defined as

$$x_i(k+1) = \Delta^{i-1} y(k+1) + \sum_{m=0}^{i-2} \beta_{i-m-1} \Delta^m u(k), \quad (19)$$

then by substituting (18) into (19),

$$x_i(k+1) = x_{i-1}(k+1) - x_{i-1}(k) + \beta_{i-1} u(k). \quad (20)$$

By using (20) recursively,

$$\begin{aligned} x_i(k+1) &= x_{i-1}(k+1) - x_{i-1}(k) + \beta_{i-1} u(k) \\ &= x_{i-2}(k+1) - x_{i-2}(k) - x_{i-1}(k) \\ &\quad + \beta_{i-2} u(k) + \beta_{i-1} u(k) \\ &= x_{i-3}(k+1) - x_{i-3}(k) - x_{i-2}(k) \\ &\quad - x_{i-1}(k) + \beta_{i-3} u(k) + \beta_{i-2} u(k) + \beta_{i-1} u(k) \\ &\quad \vdots \\ &= x_1(k+1) - x_1(k) - x_2(k) - \dots - x_{i-1}(k) \\ &\quad + \beta_1 u(k) + \beta_2 u(k) + \dots + \beta_{i-1} u(k). \end{aligned}$$

Using (16),

$$\begin{aligned} x_i(k+1) &= \sum_{m=1}^i a_m x_m(k) - \sum_{m=1}^{i-1} x_m(k) + b_0 u(k) + \sum_{m=1}^{i-1} \beta_m u(k) \\ &\quad \text{for } 2 \leq i \leq N \end{aligned} \quad (21)$$

In a matrix form, the state-difference equations of the free model in (16) and (21) is then transformed into the following linear system:

$$\begin{aligned} x(k+1) &= Ax(k) + Bu(k), \\ y(k) &= Cx(k), \end{aligned} \quad (22)$$

where

$$\begin{aligned} A &= \begin{bmatrix} a_1 & a_2 & \dots & a_N \\ a_1 - 1 & a_2 & \dots & a_N \\ \vdots & \vdots & \ddots & \vdots \\ a_1 - 1 & a_2 - 1 & \dots & a_N \end{bmatrix}, \\ B &= [b_0 \quad b_0 + \beta_1 \quad b_0 + \beta_1 + \dots + \beta_{N-1}]^T, \\ C &= [1 \quad 0 \quad \dots \quad 0], \\ x(k) &= [x_1(k) \quad x_2(k) \quad \dots \quad x_N(k)]^T. \end{aligned}$$

In this paper, the LQR technique is applied to the

free model to design a power system stabilizer. The object of the LQR design is to determine the optimal control law  $u$  which can transfer the system from its initial state to the final state such that a given performance index is minimized. The performance index is given in the quadratic form

$$J = \sum_{k=0}^{\infty} (x^T(k)Qx(k) + u^T(k)Ru(k)), \quad (23)$$

where  $Q$  is positive semi-definite, and  $R$  is positive-definite. To design the LQR controller, the first step is to select the weighting matrices  $Q$  and  $R$ . The value  $R$  weight inputs more than the states while the value of  $Q$  weight the state more than the inputs. Then, the feedback gain  $K$  can be computed and the closed-loop system responses can be found by simulation. This method has an advantage of allowing all control loops in a multi-loop system to be closed simultaneously, while guaranteeing closed-loop stability. The LQR controller is given by

$$u(k) = -Kx(k), \quad (24)$$

where  $K$  is the constant feedback gain obtained from the solution of the discrete algebraic Ricatti equation:

$$K = (B^T S B + R)^{-1} B^T S A, \quad (25)$$

$$S = A^T S A - A^T S B K + C^T Q C.$$

In conventional method to design LQR controller, the controller requires all state variables and often an observer is needed. However, the free-model based realization (22) is observable since all the states are constructed from the input-output data via (5). Therefore, an observer is not required for state feedback control. Since the realization is linear, any linear controller design method can be used.

## 5. COMPUTER SIMULATIONS

The free model concept is applied to design a PSS for a one-machine infinite-bus (OMIB) power system [10]. For the OMIB power system, the  $q$ -axis generator model, the static excitation, and turbine and governor models are used. Three simulation tasks are conducted: first, torque angle deviation is simulated in a normal load condition. Second, torque deviation is performed in a heavy load condition. Third, a three-phase fault is considered. All simulations are shown by the comparisons between the CPSS and proposed SPSA-based LQR controller. The proposed controller shows the improvement of damping performance for a simple second order free model approximation ( $N=2$ ). The  $R$  and  $Q$  for LQR are  $10^{-6}$  and

$Q_{11}=10^6$ ,  $Q_{12}=Q_{21}=0$ ,  $Q_{11}=1$ . The initial conditions for simulations are torque angle  $d = 0.9767$ , the  $d$ - $q$  axis stator current  $I_d = 0.6232$  and  $I_q = 0.8072$ , the  $d$ - $q$  axis stator voltage  $V_d = 0.4439$  and  $V_q = 0.8960$ , the internal voltage  $E_{pq} = 1.0144$ , the field voltage  $E_{fd} = 1.5023$ , and the reference voltage  $V_{ref} = 1.06$ .

### • SPSA-based free model approximation

The system is disturbed by small noise signals. Then, the system input-output pairs are obtained. The system input is the controller output in CPSS, and the system output is the angular speed ( $\omega$ ). Fig. 1 shows the comparison between the system output and the SPSA-based second-order free-model output. The SPSA-based free-model output is almost converged to system output and the root-mean square error is very small as 0.0004106. The coefficients found are  $a_1 = -0.9977$ ,  $a_2 = 0.6570$ ,  $b_0 = -0.5331$ , and  $b_1 = 0.5826$ .

### • Normal load condition

In this case, the torque angle is decreased by 0.7767 with  $P_{load}=1$  and  $Q_{load}=0.2$ . Fig. 2 shows the system performance between the CPSS and proposed

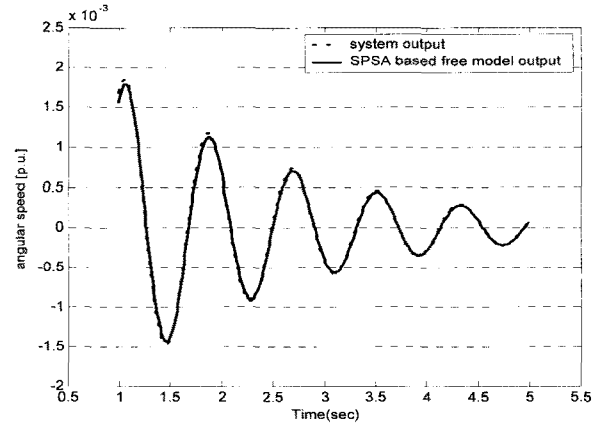


Fig. 1. Comparison between the system output and the SPSA-based free-model output.

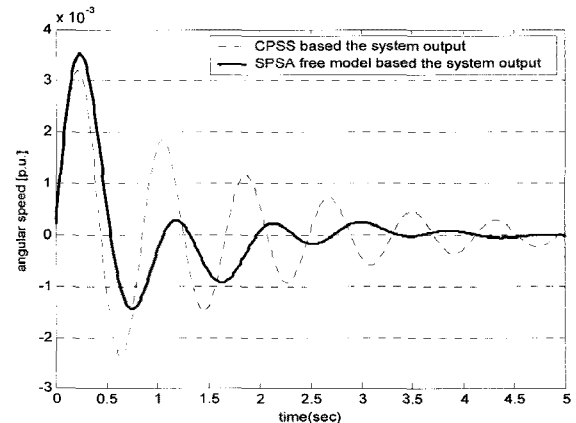


Fig. 2. Comparison of the system output between the CPSS and the proposed controller.

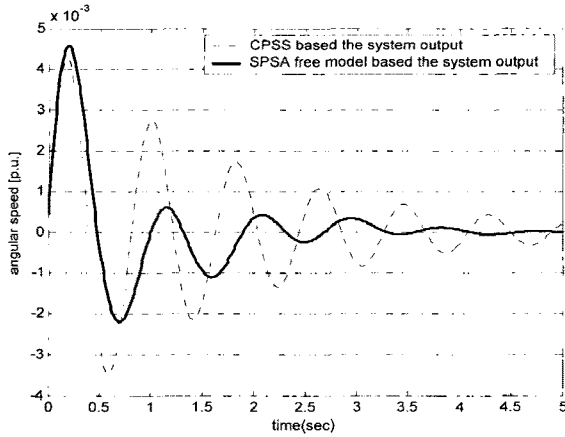


Fig. 3. Comparison of the system output between the CPSS and the proposed controller.

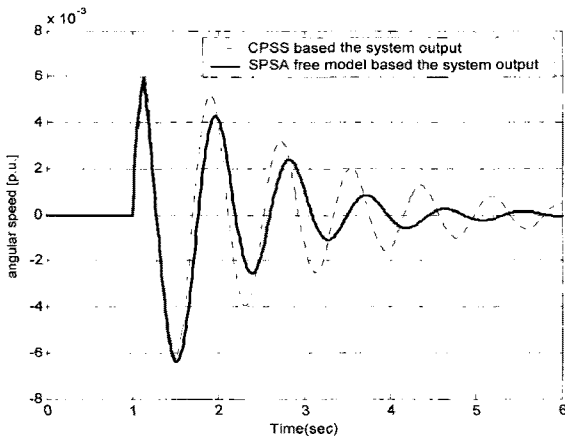


Fig. 4. Comparison of the system output between the CPSS and the proposed controller.

controller. Faster damping is recognized in the proposed controller case.

• **Heavy load condition**

In this task, the conditions of the torque angle and  $Q_{load}$  are the same as the case B. However, to evaluate the heavy load condition,  $P_{load}$  is increased by 1.2. Fig. 3 shows the system performance between the CPSS and the proposed controller. Better performance in the proposed controller is also shown.

• **Three-phased fault condition**

In this task, the conditions are as follows: a fault is occurred at 1 second, and the faulted line is disconnected at 1.04 second. Then, the faulted line is reconnected at 1.1 second. The line impedance is changed to conduct the fault conditions. For example,  $R=0.12$  and  $X=0.2$  during the fault, and  $R=0.6$  and  $X=1$  for the removal of the faulted line. Fig. 4 shows that the faster damping can be recognized in the proposed controller.

Therefore, Figs. 2, 3, and 4 show that the proposed SPSA based LQR controller is robust for a wide range

of operation conditions. Observing the figures, the angle speed is slightly higher, but almost negligibly, than the case with CPSS for the normal and heavy load conditions. However, in a more realistic fault shown in Fig. 4, the difference in angle speed is non-existent. The LQR controller minimizes the average of the oscillation according to the performance index (23). This does not discriminate any signal, DC or frequencies under oscillatory modes, which is commonly done in the conventional PSS.

**6. CONCLUSION**

This paper presented the SPSA-based free-model approximation for system identification using input and output data and its application to the design of a PSS. The free-model concept is introduced as an alternative intelligent system technique to design a controller for an unknown dynamic system with input and output data only, and it does not require the knowledge of mathematical model for the system. The idea of free model comes from the Taylor series approximation, where an output can be estimated when such data as position, velocity, and acceleration are known. The SPSA method is used to find the parameters of the free model. The free model is then transformed to a linear state space model and the LQR technique is used to design a PSS. Observer is commonly required to design LQR; however, the free model does not require the observer. The SPSA based LQR controller was implemented in a one-machine infinite-bus power system. The proposed controller was tested in various operating condition and compared with the conventional PSS. In all cases, the proposed controller out-performed the conventional PSS and thus demonstrated the usefulness of the SPSA-based LQR controller.

**APPENDIX A**

One-machine infinite-bus (OMIB) power system is shown in the one-line diagram in Fig. A1, and a conventional power system stabilizer is presented in

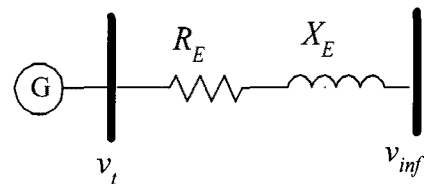


Fig. A1. A one-machine infinite-bus power system.

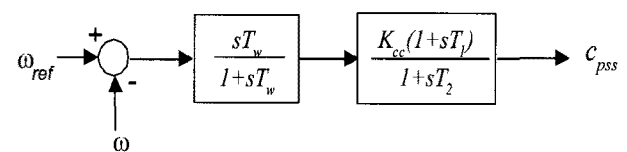


Fig. A2. A conventional PSS for comparison.

Fig. A2. The model is used for generator-turbine system [21].

#### Generator-Turbine:

$$\begin{aligned} \frac{d\delta_i}{dt} &= \omega_b(\omega_i - \omega_0), \\ M_i \frac{d\omega_i}{dt} &= (T_{m_i} - p_{e_i} - D_i(\omega_i - \omega_0)), \\ T'_{d0_i} \frac{dE'_{qi}}{dt} &= (E_{fd_i} - E'_{qi} - (x_{d_i} - x'_{d_i})I_{d_i}), \\ T_{C_i} \frac{dT_{m_i}}{dt} &= (F_{hp_i} U_{g_i} - T_{m_i} + T_{mr_i}), \\ v_d &= x_q i_q, \quad v_q = e'_q - x'_d i_d, \quad v_t^2 = v_d^2 + v_q^2, \\ T_e &\cong v_d i_d + v_q i_q. \end{aligned}$$

#### Network equation:

$$\begin{aligned} Zi &= (1 + ZY)v_t - v_0, \\ \begin{bmatrix} R & -X \\ X & R \end{bmatrix} \begin{bmatrix} i_d \\ i_q \end{bmatrix} &= \begin{bmatrix} C_1 & -C_2 \\ C_2 & C_1 \end{bmatrix} \begin{bmatrix} v_d \\ v_q \end{bmatrix} - v_0 \begin{bmatrix} \sin \delta \\ \cos \delta \end{bmatrix}, \\ C_1 &= 1 + RG - XB, \\ C_2 &= XG + RB. \end{aligned}$$

#### AVR and exciter:

$$T_{A_i} \frac{dE_{fd_i}}{dt} = (K_{A_i}(V_{ref_i} - V_i + U_{pssi}) - E_{fd_i}).$$

#### Governor (GOV):

$$T_{g_i} \frac{dU_{g_i}}{dt} = (K_{g_i}(\omega_{ref_i} - \omega_i) - U_{g_i}).$$

#### Generator parameters in p.u.:

$$\begin{aligned} x_d &= 0.973, \quad x'_d = 0.19, \quad x_q = 0.55, \quad T'_{d0} = 7.76, \\ M &= 9.26, \quad D = 0.01, \quad F_{hp} = 1, \quad T_c = 0.1. \end{aligned}$$

#### AVR and GOV parameters:

$$K_A = 25, \quad T_A = 0.05, \quad K_g = 10, \quad T_g = 0.1.$$

#### Transmission line parameters in p.u.:

$$R_E = 0.03, \quad X_E = 0.5.$$

#### Constants of a conventional PSS for comparison:

$$T_1 = 0.685, \quad T_2 = 0.1, \quad T_w = 3, \quad K_{cc} = 7.091.$$

#### REFERENCES

- [1] F. P. deMello and C. A. Concordia, "Concept of synchronous machine stability as affected by excitation control," *IEEE Trans. on Power Apparatus and Systems*, vol. 103, pp. 316-319, 1969.
- [2] S. S. Lee, S. H. Kang, G. S. Jang, S. Y. Li, J. K. Park, S. I. Moon, and Y. T. Yoon, "Damping analysis using IEEEEST PSS and PSS2A PSS," *Journal of Electrical Engineering & Technology*, vol. 1, no. 3, pp. 271-278, 2006.
- [3] S. A. Doi, "Coordinated synthesis of power system stabilizers in multimachine power systems," *IEEE Trans. on Power Apparatus and Systems*, vol. 103, pp. 1473-1479, 1984.
- [4] T. L. Hwang, T. Y. Hwang, and W. T. Yang, "Two-level optimal output feedback stabilizer design," *IEEE Trans. on Power Systems*, vol. 6, no. 3, pp.1042-1047, 1991.
- [5] K. T. Law, D. J. Hill, and N. R. Godfrey, "Robust controller structure for coordinate power system voltage regulator and stabilizer design," *IEEE Trans. Control Sys. Tech.*, vol. 2, no. 3, pp. 220-232, 1994.
- [6] A. Ghosh, G. Ledwich, O. P. Malik, and G. S. Hope, "Power system stabilizer based on adaptive control techniques," *IEEE Trans. on Power Apparatus and Systems*, vol. 103, pp. 1983-1989, 1984.
- [7] W. Gu and K. E. Bollinger, "A self-tuning power system stabilizer for wide-range synchronous generator operation," *IEEE Trans. on Power Systems*, vol. 4, no. 2, pp. 1191-1199, 1989.
- [8] O. P. Malik and C. Mao, "An adaptive optimal controller and its application to an electric generating unit," *Int. J. Electr. Power Energy Generating Unit*, vol. 15, pp. 169-178, 1993.
- [9] Y. Zhang, O. P. Malik, G. S. Hope, and G. P. Chen, "Application of an inverse input/output mapped ANN as a power system stabilizer," *IEEE Trans. on Energy Conversion*, vol. 9, no. 3, pp. 433-441, 1994.
- [10] K. Y. Lee and H. S. Ko, "Power system stabilization using free-model based inverse dynamic neuro controller," *Proc. of Int. Joint Conf. Neural Network*, no. 3, pp. 2132-2137, 2002.
- [11] K. A. El-Metwally and O. P. Malik, "Fuzzy logic power system stabilizer," *IEE Proc. Generation Transmission Distribution*, vol. 143, no. 3, pp. 263-268, 1996.
- [12] Y. Y. Hsu and C. H. Cheng, "Design of fuzzy power system stabilizers for multi-machine power systems," *IEE Proc. Generation Transmission Distribution*, vol. 137, no. 3, pp. 233-238, 1990.
- [13] R. A. Hooshmand and M. Ataei, "Real-coded genetic algorithm based design and analysis of an auto-tuning fuzzy logic PSS," *Journal of Electrical Engineering & Technology*, vol. 2, no. 2, pp. 178-187, 2007.
- [14] J. C. Spall, "Multivariate stochastic approxi-




mation using a simultaneous perturbation gradient approximation," *IEEE Trans. on Automatic Control*, vol. 37, pp. 332-341, 1992.

- [15] J. C. Spall, *Introduction to Stochastic Search and Optimization: Estimation, Simulation, and Control*, Wiley, 2003.
- [16] B. D. O. Anderson and J. B. More, *Linear Optimal Control*, Prentice Hall, New Jersey, 1990.
- [17] P. W. Sauer and M. A. Pai, *Power System Dynamics and Stability*, Prentice Hall, New Jersey, 1998.
- [18] P. M. Anderson and A. A. Fouad, *Power Systems Control and stability*, Iowa State University Press, USA, 1984.
- [19] C. L. Phillips and H. T. Nagle, *Digital Control System Analysis and Design*, Prentice Hall, 1997.
- [20] K. Ogata, *Discrete-Time Control System*, Prentice Hall, 1995.
- [21] M. A. Pai, C. D. Vournas, A. N. Michel, and H. Ye, "Application of interval matrices in power system stabilizer design," *Int. J. Elec. Power Energy Syst.*, vol. 19, no. 3, pp. 179-184, 1997.



**Hee-Sang Ko** received the B.S. degree in Electrical Engineering from Cheju National University, Jeju, Korea, in 1996, the M.Sc. degree in Electrical Engineering from the Pennsylvania State University, University Park, USA, in 2000, and the Ph.D. degree in Electrical and Computer Engineering from the University of British

Columbia, Vancouver, Canada, in 2006. He is a Researcher in the cooperation planning team at Samsung Heavy Industries Company, Korea. His research interests include wind power generation, power systems voltage and transient stability, data processing for power systems security analysis, electricity market analysis, and system identification.



**Kwang Y. Lee** received the B.S. degree in Electrical Engineering from Seoul National University, Korea, in 1964, the M.S. degree in Electrical Engineering from North Dakota State University, Fargo, in 1968, and the Ph.D. degree in System Science from Michigan State University, East Lansing, in 1971. He has been with

Michigan State, Oregon State, Univ. of Houston, the Pennsylvania State University, and Baylor University where he is currently a Professor and Chair of Electrical and Computer Engineering. His interests include power system control, operation, planning, and intelligent system applications to power systems. Dr. Lee is a Fellow of IEEE, Associate Editor of IEEE Transactions on Neural Networks, and Editor of IEEE Transactions on Energy Conversion. He is also a registered Professional Engineer.



**Ho-Chan Kim** received the B.S., M.S., and Ph.D. degrees in Control & Instrumentation Engineering from Seoul National University in 1987, 1989, and 1994, respectively. He was a Research Staff from 1994 and 1995 at the Korea Institute of Science and Technology (KIST). Since 1995, he has been with the Department of

Electrical Engineering at Cheju National University, where he is currently a Professor. He was a Visiting Scholar at the Pennsylvania State University in 1999. His research interests include wind power system control, electricity market analysis, and grounding systems.